


CONFORMED DRAWING
02/3/06
SIGNED AND SEALED
COPY IS KEPT ON FILE

**Joseph R. Loring
& Associates, Inc.**
consulting engineers

THE OFFICE OF
DAVID
ELLIOT
LEIBOWITZ
PC
ADVERTISING • PUBLICITY
10 WEST 47TH STREET NEW YORK, NY 10036
Tel. 212.664.4100 Fax: 212.664.0000

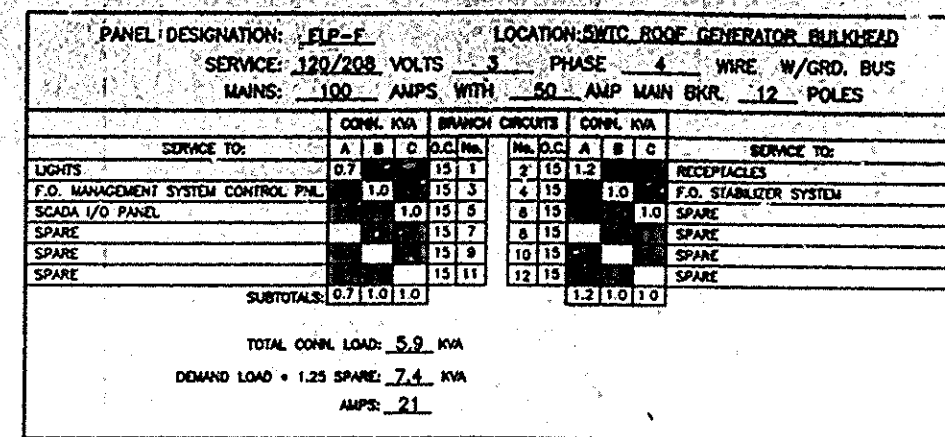

- [illegible]

Contract Number	Drawing Number
WTC-945.071	E3-02

(E86) (E7) (E8)

CUT EXIST. RACEWAY. PROVIDE JUNCTION BOX AT END OF EXISTING RACEWAY WIRING FOR SPLICING EXTENSION TO RELOCATED CONDENSERS

EXISTING JUNCTION BOX TO REMAIN

REMOVE EXISTING WIRING AND CONDENSE. JUNCTION BOX TO REMAIN

EXISTING 2" PIPE TO REMAIN

REROUTING OF 3-3/4" CONDUITS. PROVIDE NEW CABLES TO MATCH EXISTING AND MEET EQUIPMENT REQUIREMENTS OF SYSTEM SERVED

EXISTING AIR GRILL

EXISTING AIR GRILL

EXISTING PASSAGE

RELOCATE EXIST. SWS. TO BE MOUNTED NEXT TO RELOCATED EXISTING CONDENSERS. EXTEND AND CONNECT AS REQUIRED

REMOVE EXIST. 3/4" R. WIRING AS SHOWN. PROVIDE JUNCTION BOXES BOTH ENDS

EXISTING AIR COOLED CONDENSER TO BE RELOCATED ABOVE F.O. TANK ROOM

PROPOSED LOCATION OF DOOR ENTRANCE TO AIR PLENUM AREA. SEE ARCHITECTURAL DRAWINGS

WEST ELEVATION OF EXISTING CONDITION
AT F.O. TANK ROOM FOR MODIFICATIONS

The World Trade Center

ELECTRICAL

5WTC FUEL OIL

TANK ROOM

POWER PLAN